
BONDING AND GROUNDING OF FLAMMABLE LIQUIDS CONTAINERS MINIMIZES STATIC SPARKS WHICH CAN CAUSE EXPLOSIONS AND FIRES

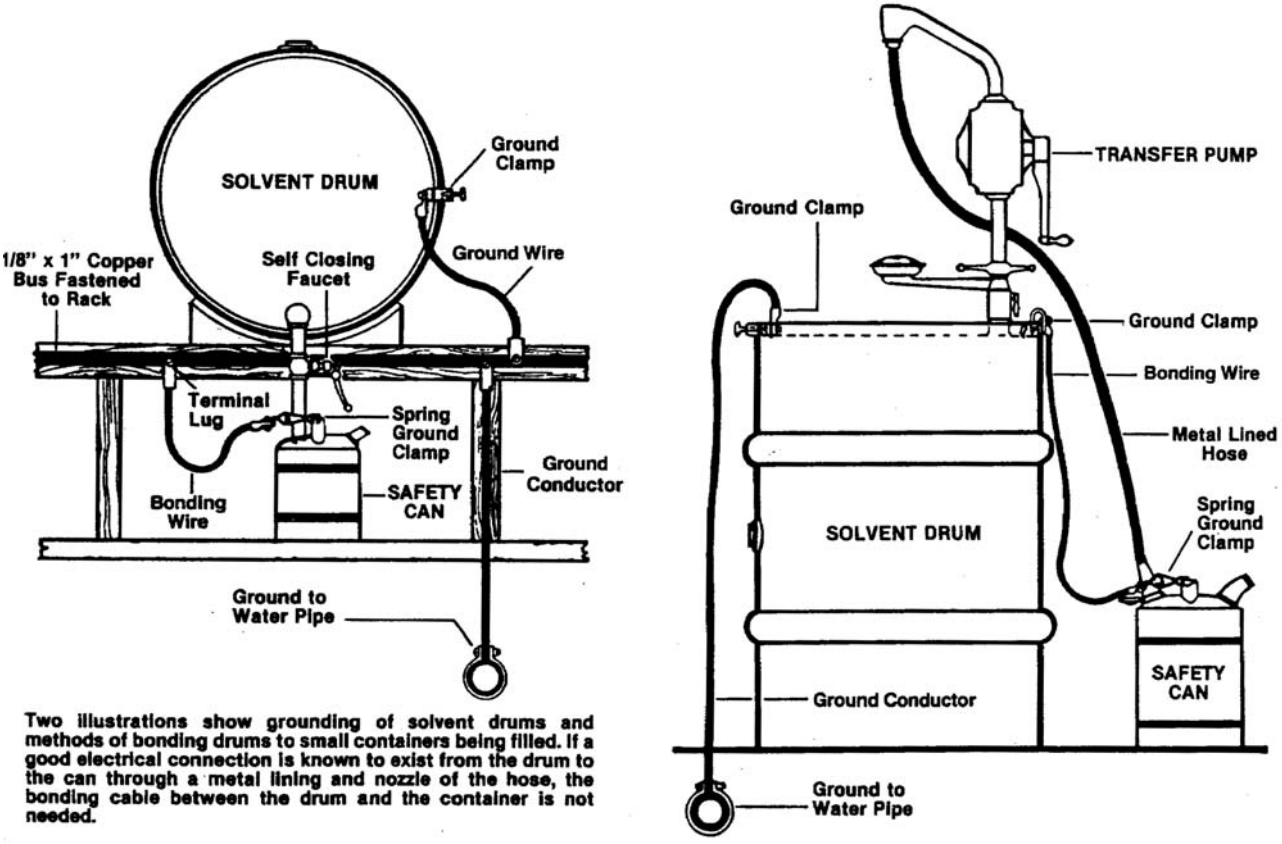

Two illustrations show grounding of solvent drums and methods of bonding drums to small containers being filled. If a good electrical connection is known to exist from the drum to the can through a metal lining and nozzle of the hose, the bonding cable between the drum and the container is not needed.

Refer NFPA 30 Flammable and Combustible Liquids Code for details.